



Operational Excellence Services

**Health · Safety · Environment
(HSE)**

Active Fire Protection Assessment



Contact Us

 [Technology Inquiries | Contact Us | JGC HOLDINGS CORPORATION](#)

Access to Our Homepage

 <https://www.jgc.com/en/business/epc/operation-maintenance/service/>

Active Fire Protection Assessment

Do you have any of these issues?

- ☹ **Fire and explosion incidents**
- ☹ **Modification of facility**
- ☹ **High maintenance and inspection cost**
- ☹ **High insurance fees**

Active Fire Protection Assessment Solution

- Re-evaluation for facilities based on credible fire scenario and codes and standards
- Fire scenario simulation based on identified fire scenario
- Fire fighting system evaluation by:
 - Hydraulic calculation
 - Fire water monitor coverage assessment
 - Foam system performance evaluation
 - Etc.




Foam Extinguisher System



Monitor Protection




Water Spray Protection

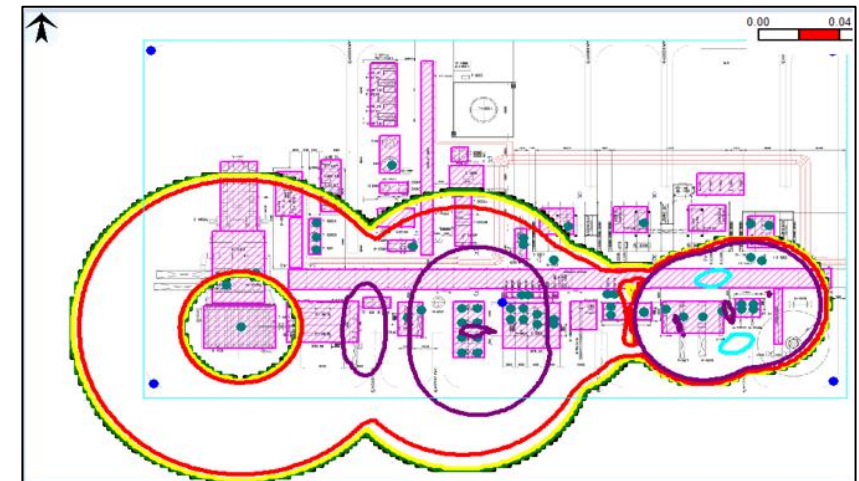


Example of Jet Fire Risk Contour


Workflow & Result

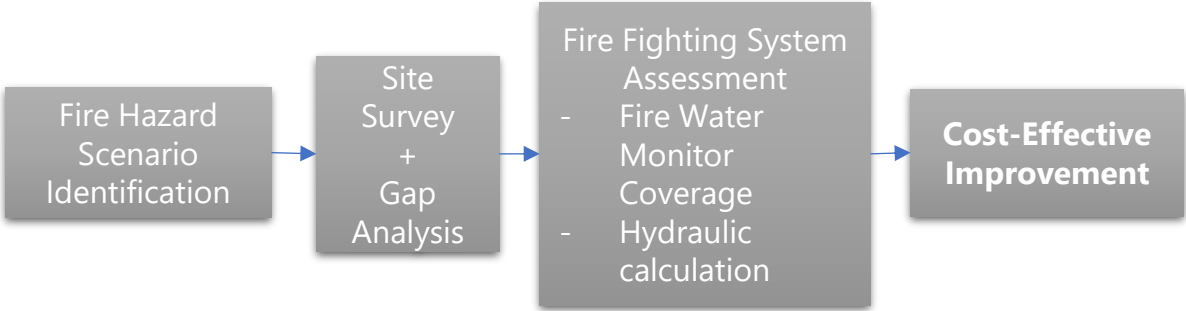

Fire Hazard Scenario + Fire Water Monitor Coverage Assessment

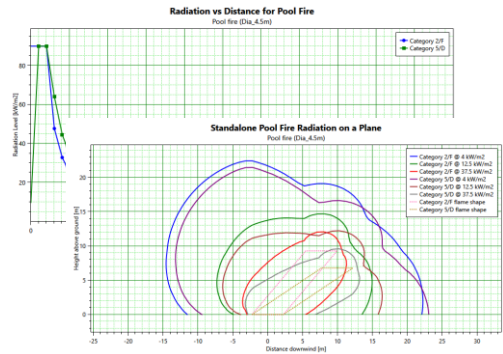

Fire Hazard Simulation

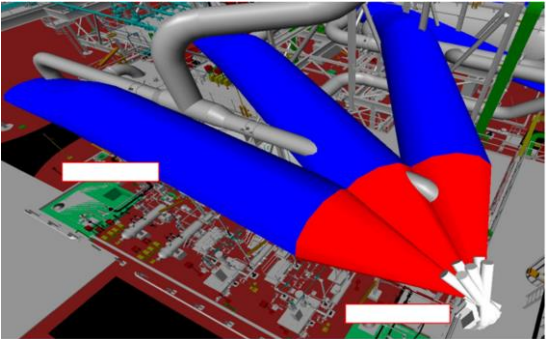

Visualizing Monitor Coverage in 3D model

Our Strengths

- **Professional Fire Protection and Analysis Teams**
- **Top global** experience in active fire protection design and application from EPC execution
Plant type - Refinery, Gas Processing, LNG, Chemical
Plant location – Onshore, Offshore
Client – IOCs, NOCs
Code and Standards – NFPA, API, BS, etc.
- **Strong relationships with global firefighting equipment suppliers**
- **Analysis software** – Phast (DNV), FLACS (Gexcon), in-house simulation,

Our Experiences

20+
Studies

Fire water monitor coverage assessment 20+ studies.

500+
Cases

Active fire protection design 500+ cases